


流入水、放流水の水質経年変化(1988~2022年度)

宍道湖西部浄化センター

水質データ経年変化

T-N (全窒素)

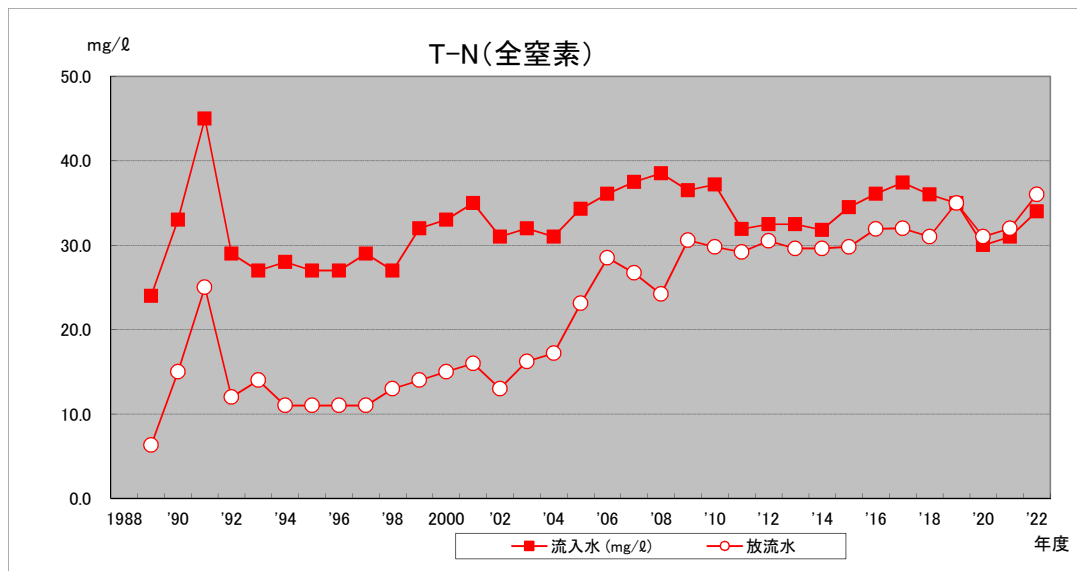

T-N (全窒素)

	流入水	放流水
	(mg/l)	
1988		
'89	24.0	6.3
'90	33.0	15.0
'91	45.0	25.0
'92	29.0	12.0
'93	27.0	14.0
'94	28.0	11.0
'95	27.0	11.0
'96	27.0	11.0
'97	29.0	11.0
'98	27.0	13.0
'99	32.0	14.0
2000	33.0	15.0
'01	35.0	16.0
'02	31.0	13.0
'03	32.0	16.2
'04	31.0	17.2
'05	34.3	23.1
'06	36.1	28.5
'07	37.5	26.7
'08	38.5	24.2
'09	36.5	30.6
'10	37.2	29.8
'11	31.9	29.2
'12	32.5	30.5
'13	32.5	29.6
'14	31.8	29.6
'15	34.5	29.8
'16	36.1	31.9
'17	37.4	32.0
'18	36.0	31.0
'19	35.0	35.0
'20	30.0	31.0
'21	31.0	32.0
'22	34.0	36.0