


# 流入水、放流水の水質経年変化(1981~2022年度)

宍道湖東部浄化センター

水質データ経年変化

## T-N (全窒素)

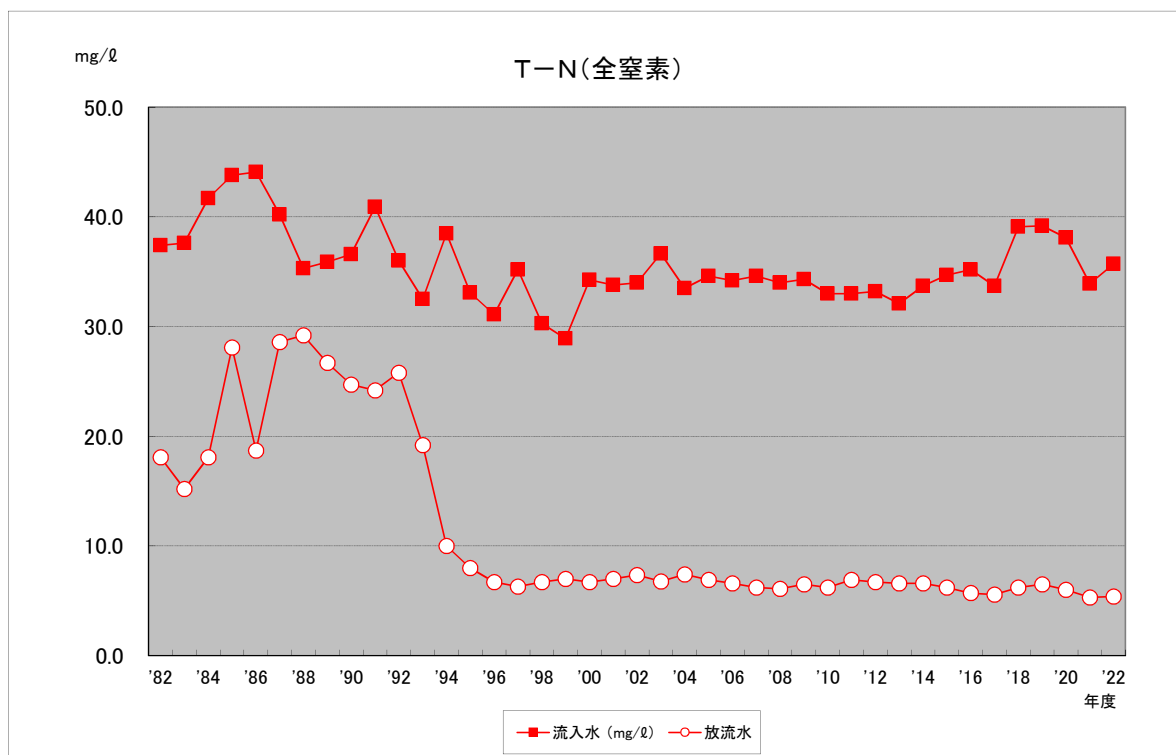

※放流水の法定基準: 20mg/l

## T-N (全窒素)

	流入水	放流水
	(mg/l)	
1981	35.2	15.3
'82	37.4	18.1
'83	37.6	15.2
'84	41.7	18.1
'85	43.8	28.1
'86	44.1	18.7
'87	40.2	28.6
'88	35.3	29.2
'89	35.9	26.7
'90	36.6	24.7
'91	40.9	24.2
'92	36.0	25.8
'93	32.5	19.2
'94	38.5	10.0
'95	33.1	8.0
'96	31.1	6.7
'97	35.2	6.3
'98	30.3	6.7
'99	28.9	7.0
'00	34.2	6.7
'01	33.8	7.0
'02	34.0	7.4
'03	36.6	6.8
'04	33.5	7.4
'05	34.6	6.9
'06	34.2	6.6
'07	34.6	6.2
'08	34.0	6.1
'09	34.3	6.5
'10	33.0	6.2
'11	33.0	6.9
'12	33.2	6.7
'13	32.1	6.6
'14	33.7	6.6
'15	34.7	6.2
'16	35.2	5.7
'17	33.7	5.6
'18	39.1	6.2
'19	39.2	6.5
'20	38.1	6.0
'21	33.9	5.3
'22	35.7	5.4